

# STANDARD APPLICATION



## OPERATOR RESPONSIBILITIES



CHARGING DISCIPLINE



WATER FILLING



VIGILANCE



## WHEN? DO YOU CHARGE?

*At the end of a work shift where more than 20% capacity was used.*

*Every weekend, regardless of usage.*



END OF SHIFT

+



USED CAPACITY



EVERY WEEKEND


## BEFORE! DISCONNECTING

*IMPORTANT! Never disconnect the battery while the charger is working.*

*IN CASE OF EMERGENCY, stop the charger by pressing "UP" for 2 seconds.*



PRESS 2 SEC.

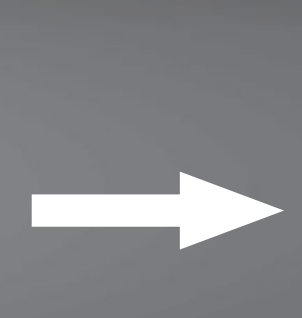


HAUT  
UP

## WHEN? TO ADD WATER?

*Only after an equalization charge. If you do not have an automatic filling system, fill each cell from 1/4" to 1/2" above the plates with distilled water.*



AFTER EQUALIZING

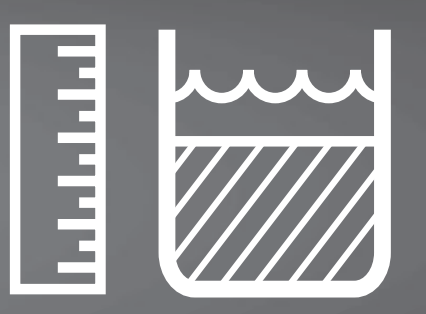

1/4" - 1/2"



*Vigilant operators that are proactive at the various operation tasks greatly contribute not only to their own health and safety, but also to assure that equipments function optimally and don't wear prematurely. Simply being on the lookout for anomalies (excess heat and dust, water spills) can prevent bodily damage or even major equipment failure.*